

0H0171

WEIGHT DATA		
WEIGHT (GENSET ONLY) KG (LLBS)	WEIGHT (WOODEN SHIPPING CRATE/SKID) KG (LLBS)	SHIPPING WEIGHT (SKID AND GENSET) KG (LLBS)
617 [1360]	44 [98]	661 [1458]

NOTES:


- 1) MINIMUM RECOMMENDED CONCRETE PAD SIZE: 1155 (45.5") WIDE X 2255 (88.8") LONG. REFERENCE INSTALLATION GUIDE SUPPLIED WITH UNIT FOR CONCRETE PAD GUIDELINES.
- 2) ALLOW SUFFICIENT ROOM ON ALL SIDES OF THE GENERATOR FOR MAINTENANCE AND SERVICING. THIS UNIT MUST BE INSTALLED IN ACCORDANCE WITH CURRENT APPLICABLE NFPA 37 AND NFPA 70 STANDARDS AS WELL AS ANY OTHER FEDERAL, STATE AND LOCAL CODES FOR MINIMUM DISTANCES FROM OTHER STRUCTURES.
- 3) CIRCUIT BREAKER INFORMATION:
SEE SPECIFICATION SHEET WITHIN OWNERS MANUAL
- 4) INSIDE STUB-UP AREA FOR AC LOAD LEAD CONDUIT CONNECTION, NEUTRAL CONNECTION, BATTERY CHARGER 120 VOLT AC (.5 AMP MAX.) CONNECTION, AND ACCESS TO TRANSFER SWITCH CONTROL WIRES. REMOVE FRONT COVER FOR ACCESS.
- 4A) FIELD CUT HOLE IS ONLY REQUIRED FOR MOUNTING OF GENERATOR ON AN EXISTING PAD.
- 5) REFERENCE OWNERS MANUAL FOR LIFTING WARNINGS.
- 6) REMOVE EITHER LEFT OR RIGHT HAND SIDE PANEL TO ACCESS EXHAUST MUFFLER AND FAN BELT.

NATURAL GAS
LINE CONNECTION
3/4" NPT FEMALE
COUPLING

BATTERY 12 VOLT 24F
525 COLD CRANKING AMPS

SERVICE ITEM	THRU LEFT DOOR
OIL FILL CAP	THRU LEFT DOOR
OIL DIP STICK	THRU LEFT DOOR
OIL FILTER	THRU LEFT DOOR
OIL DRAIN HOSE	THRU RIGHT DOOR
RADIATOR DRAIN HOSE	THRU RIGHT DOOR
AIR CLEANER ELEMENT	THRU RIGHT DOOR
SPARK PLUGS	BOTH DOORS
MUFFLER	SEE NOTE 6
FAN BELT	SEE NOTE 6
BATTERY	THRU RIGHT DOOR


REFERENCE OWNERS MANUAL FOR PERIODIC
REPLACEMENT PART LISTINGS

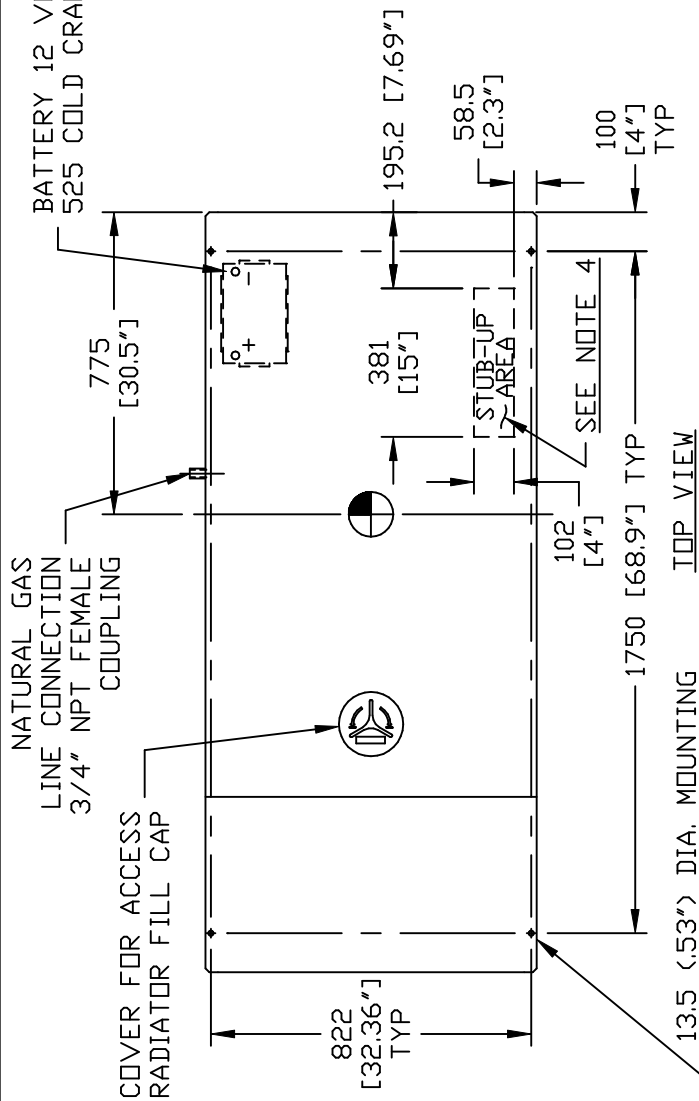

WISE ACTION LATCH,
ONE PER DOOR, ONE LIFT-OFF
DOOR PER SIDE OF GENERATOR

CONTROL PANEL R200 TYPE
BATTERY CHARGER IS
ENCLOSED WITHIN

EXHAUST AND AIR DISCHARGE
LOUVERS - FRONT AND SIDES

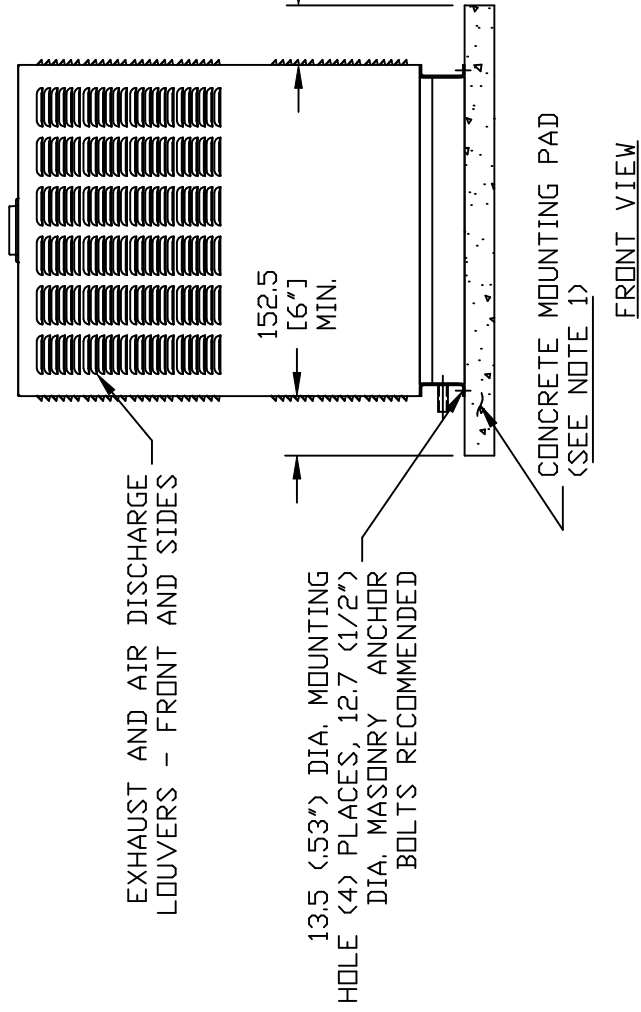

EXHAUST MUFFLER
ENCLOSED WITHIN,
SEE NOTE 6

FRONT COVER
SEE NOTE 4

CIRCUIT BREAKER
SEE NOTE 3

AIR INLET
LOUVERS

13.5 (.53") DIA. MOUNTING HOLE (4) PLACES, 12.7 (1/2") DIA. MASONRY ANCHOR BOLTS RECOMMENDED

NATURAL GAS LINE CONNECTION
3/4" NPT FEMALE COUPLING
LOCATED ON OPPOSITE SIDE (RH)

LIFTING PROVISION
(4) PLACES, SEE NOTE 5 AND
CENTER OF GRAVITY DIMENSIONS

FIELD CUT HOLE FOR OUTSIDE CONDUIT
CONNECTION ONLY, SEE NOTE 4A

LEFT SIDE VIEW

GENERAC POWER SYSTEMS OWNS THE COPYRIGHT OF THIS DRAWING WHICH IS SUPPLIED IN CONFIDENCE AND MUST NOT BE USED FOR ANY PURPOSE OTHER THAN FOR WHICH IT IS SUPPLIED WITHOUT THE EXPRESS WRITTEN CONSENT OF GENERAC POWER SYSTEMS.

© GENERAC POWER SYSTEMS 2001

QT48

4.2L (48KW) - G3

GENERAC POWER
SYSTEMS
Waukesha
P.O. BOX 8
WAUKESHA, WIS. 53187

FILE NAME 0H0171-A.DWG SIZE B

SCALE 1 = 20 FIRST USE QT SERIES

DWG NO. 0H0171 REV A

INSTALLATION DRAWING

ENCLOSURE - C2

ISSUE DATE 8/29/08